



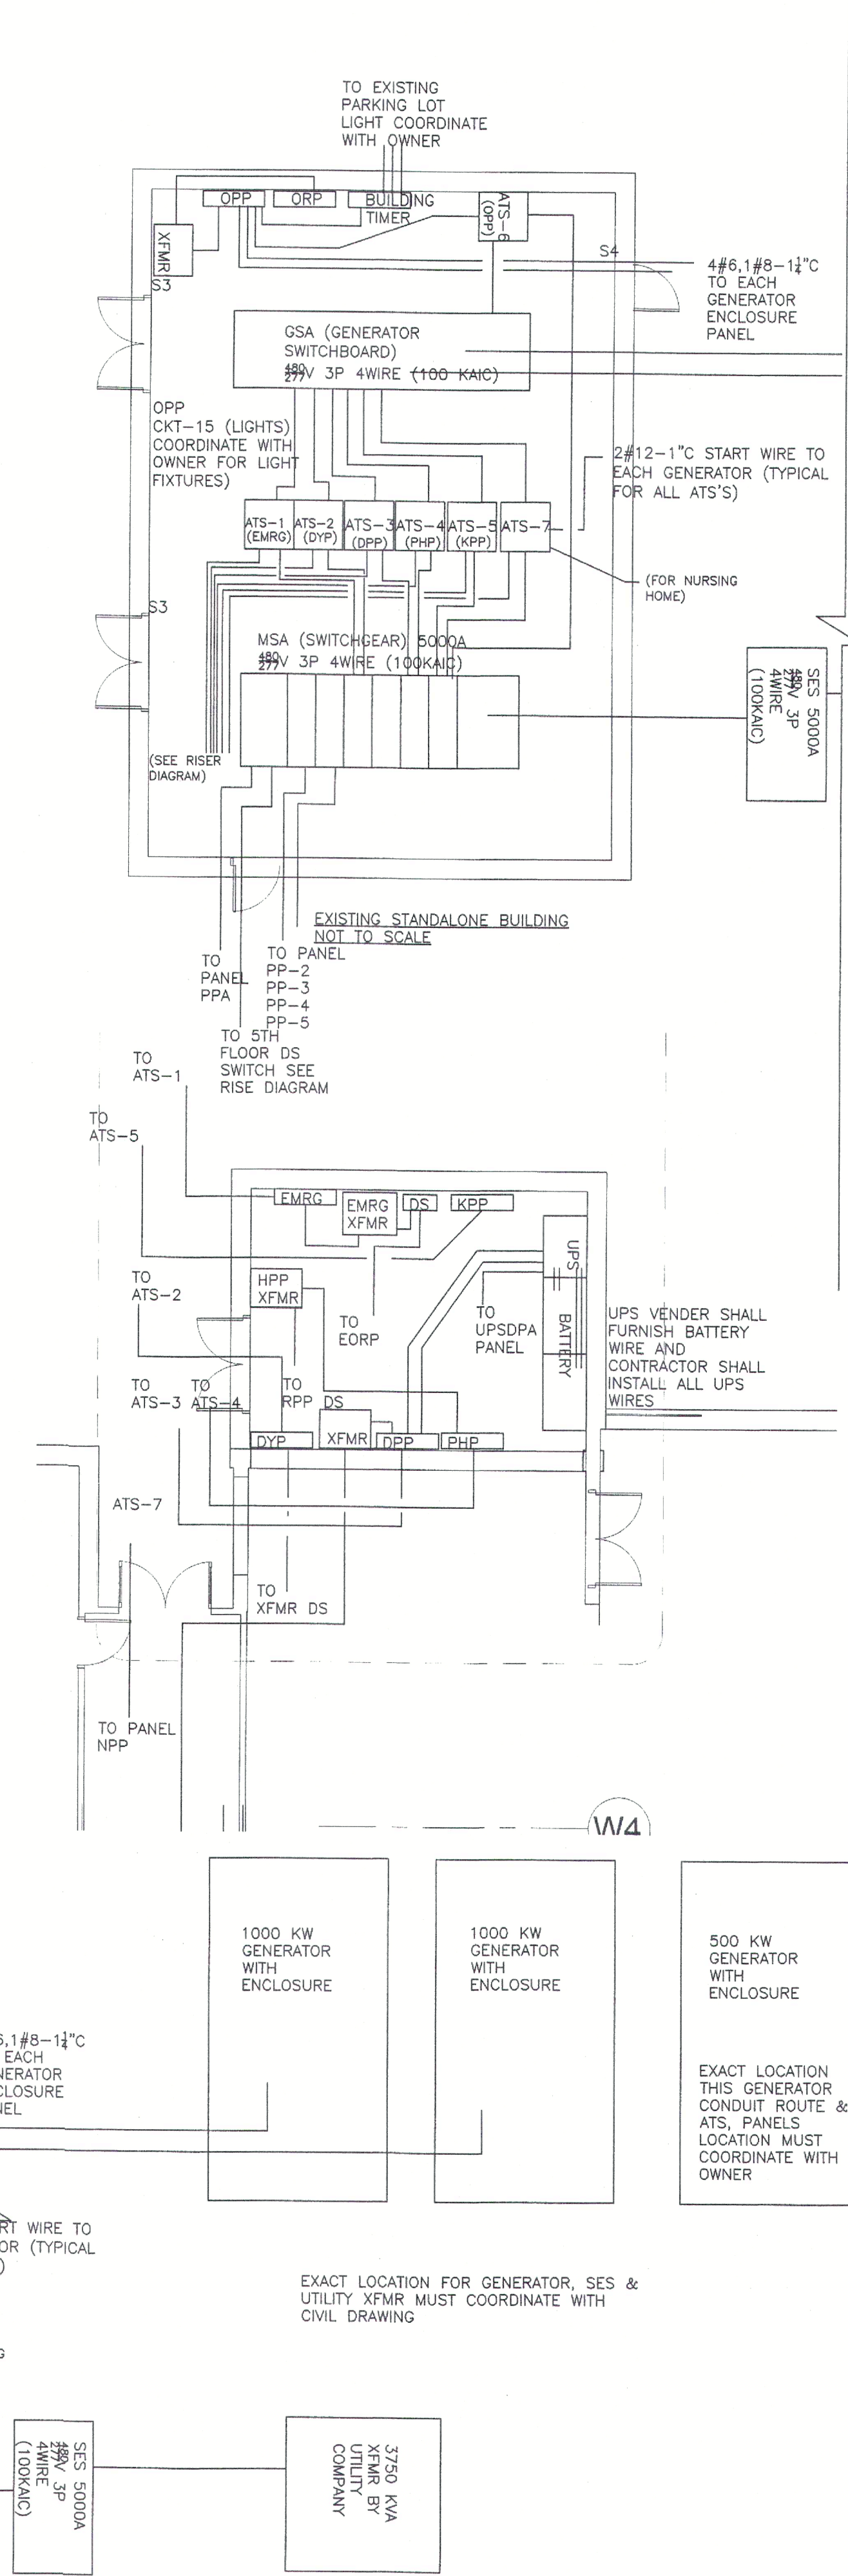

ELECTRICAL CONTRACTOR SHALL FOLLOW NEC 2014, SECTION 406.12: TAMPER-RESISTANT RECEPTACLES IN DWELLING UNITS IN ALL NONLOCKING-TYPE 125-VOLT, 15- AND 20-AMPERE RECEPTACLES SHALL BE PROVIDED TAMPER-RESISTANT RECEPTACLES. (TYPICAL FOR UNIT UNITS)

PROVIDE AND INSTALL ALL EXIT SIGNS, LIGHTS, SWITCHES, EMERGENCY LIGHTS AS REQUIRED BY ALL APPLICABLE CODES.

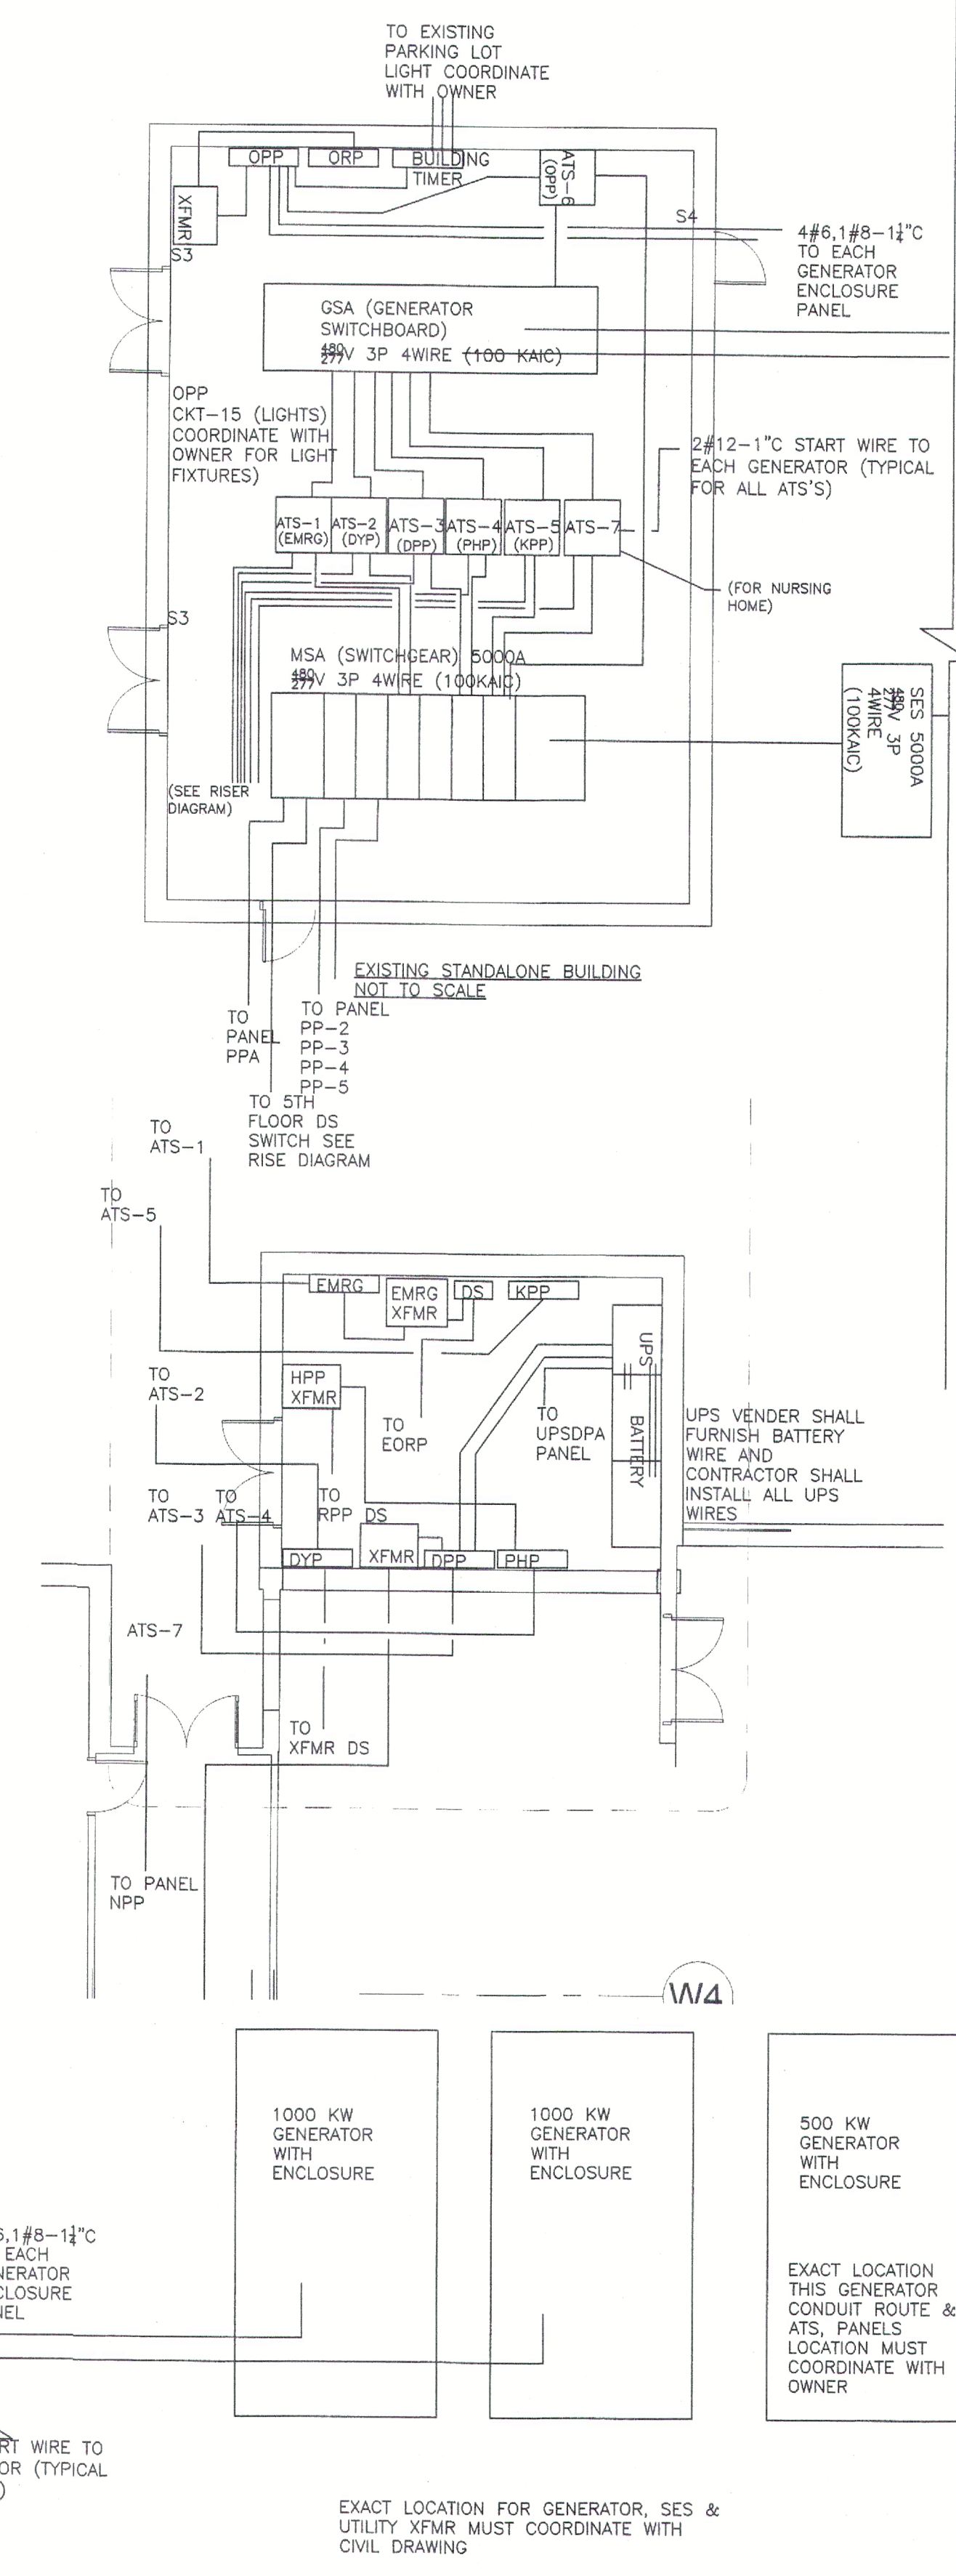

Scale $1/8" = 1'-0"$