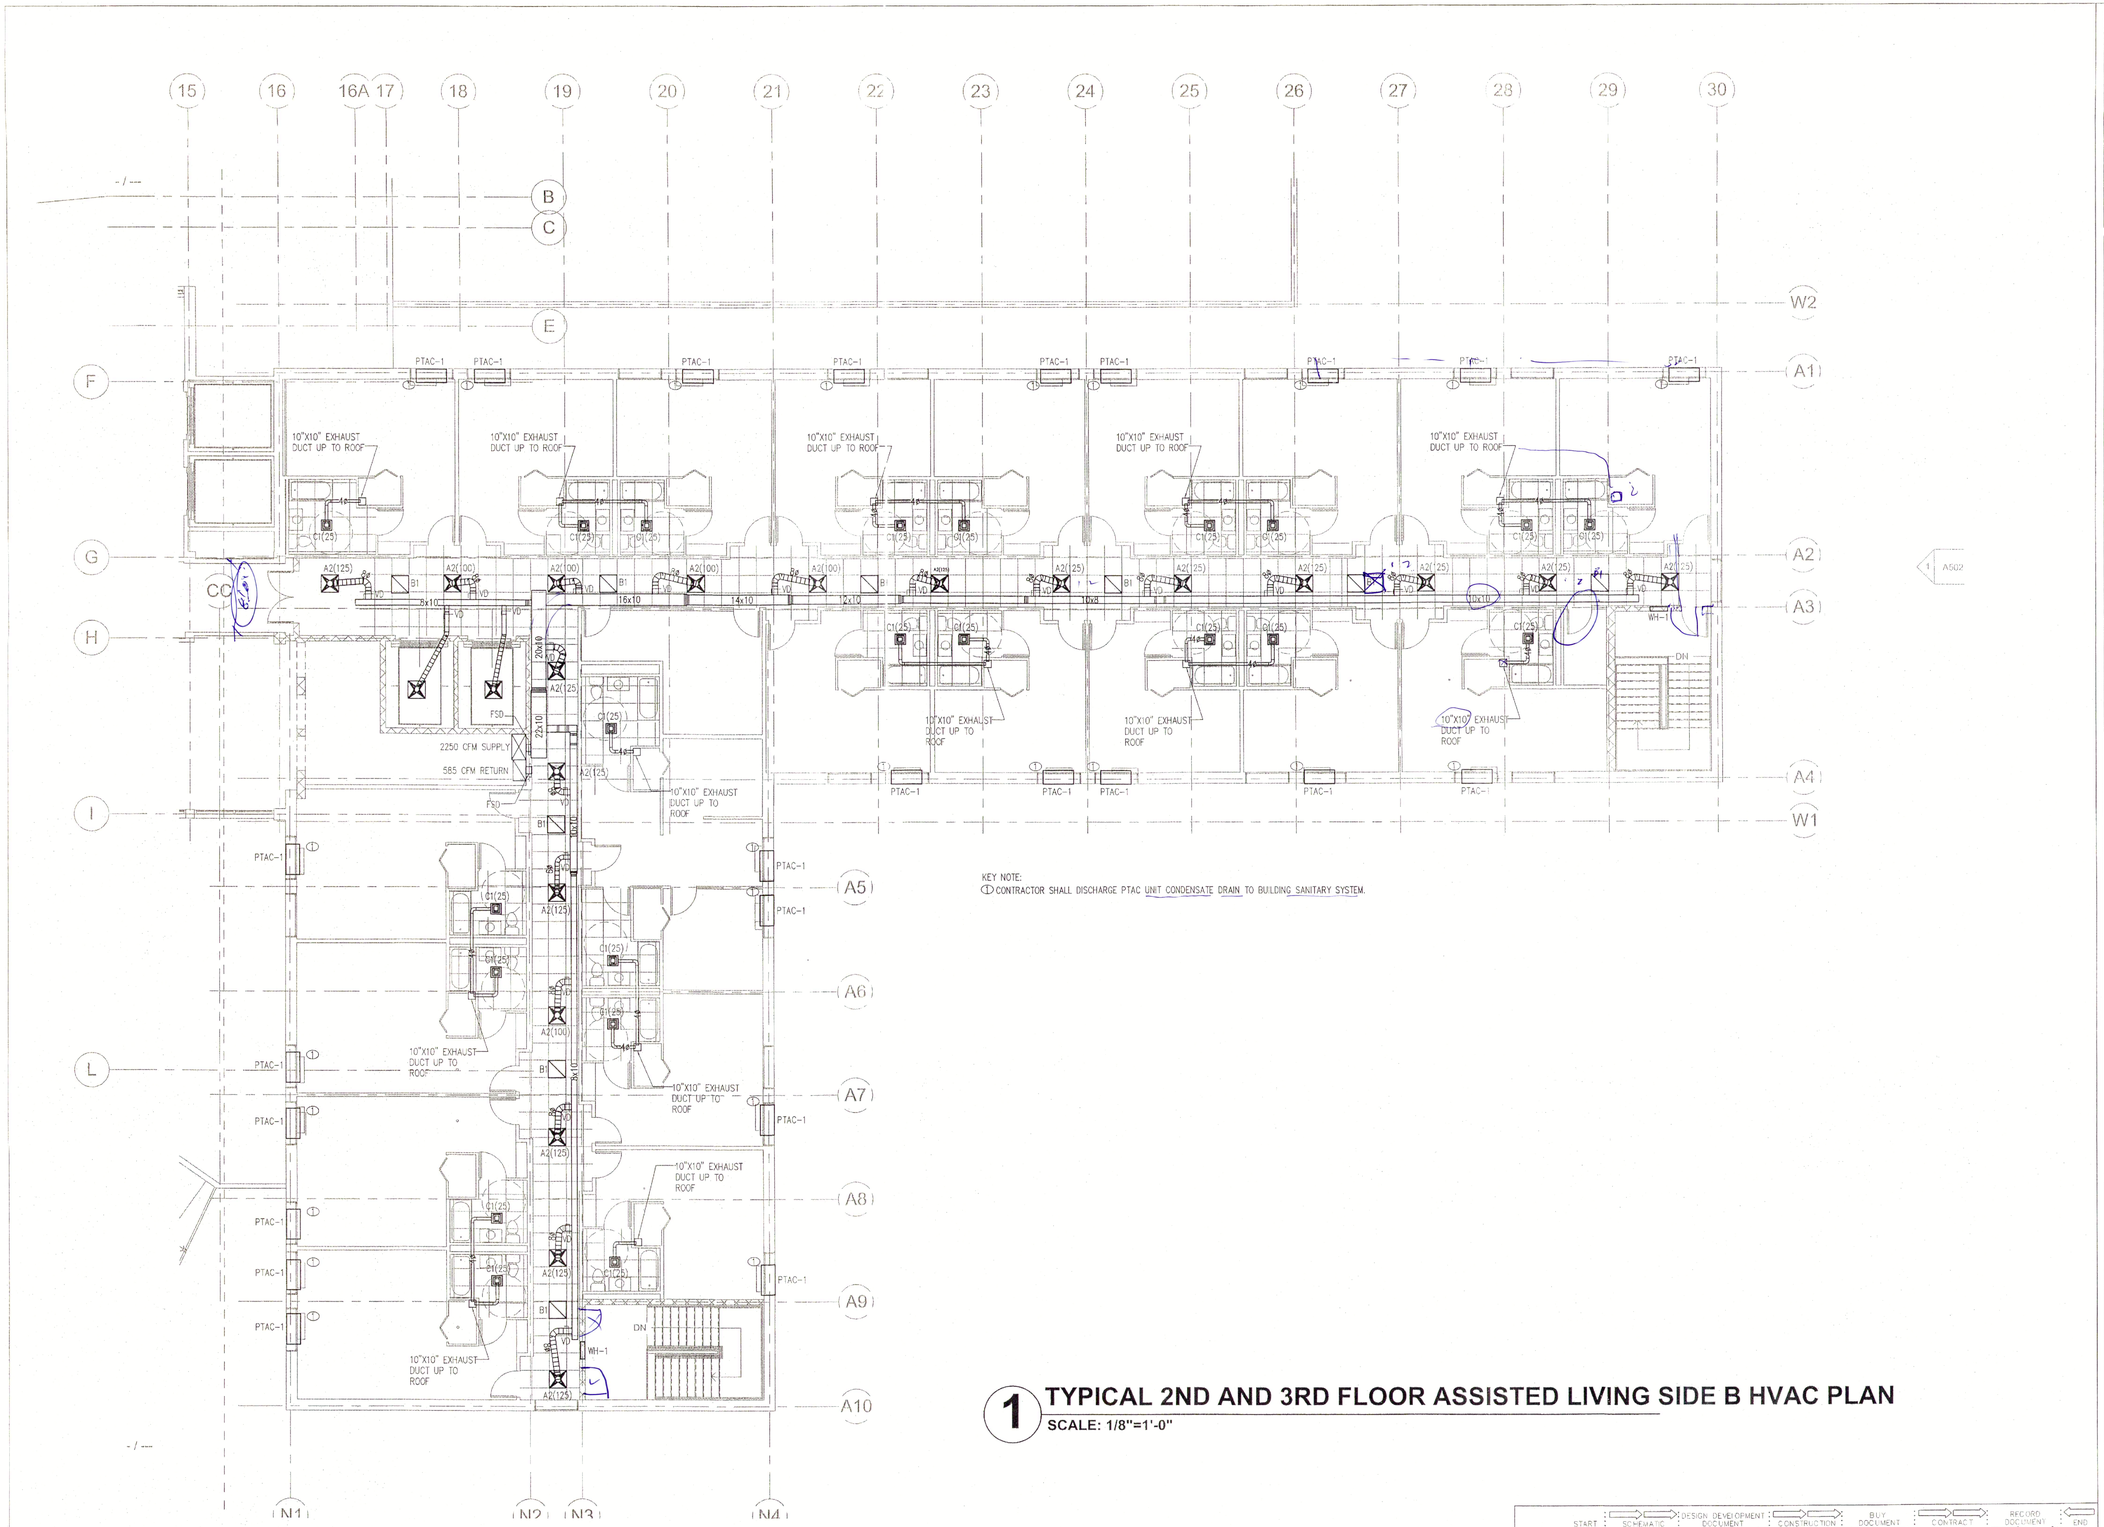

KEY NOTE:
1. CONTRACTOR SHALL DISCHARGE PTAC UNIT CONDENSATE DRAIN TO BUILDING SANITARY SYSTEM.

1 TYPICAL 2ND AND 3RD FLOOR ASSISTED LIVING SIDE B HVAC PLAN

SCALE: 1/8"=1'-0"

	START	SCHEMATIC DOCUMENT	DESIGN DEVELOPMENT DOCUMENT	CONSTRUCTION DOCUMENT	BUY DOCUMENT	CONTRACT DOCUMENT	RECORD DOCUMENT	END
ISSUE DATE:	09/01/15							
BY:								
A.T.P. DATE:								
BY:								

• PHP comments
Marks by pravin

PROFESSIONAL CERTIFICATION

I CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED ARCHITECT UNDER THE LAWS OF THE STATE OF PENNSYLVANIA:

LICENSE NO._____ EXPIRING ON _____

PRAVIN PATEL, P.E.
PATEL ENGINEERING
19 SCHERER COURT
LAWRENCEVILLE, NJ 08648

TEL: - 609 955 1677

No.	Description	Date

Manny Mathai

HEALTHCARE FACILITIES

2ND FLOOR SIDE B
HVAC PLAN

Project number	SK-2015-006
Date	10/14/2015
Drawn by	Author
Checked by	Checker
	M-2.1
Scale	1/8" = 1'-0"

10/3/2016 8:42:59 AM